
All wall charts and wall racks are optional. The way to connect with a city water line will be determined by customer. Connecting adapter is available by request.

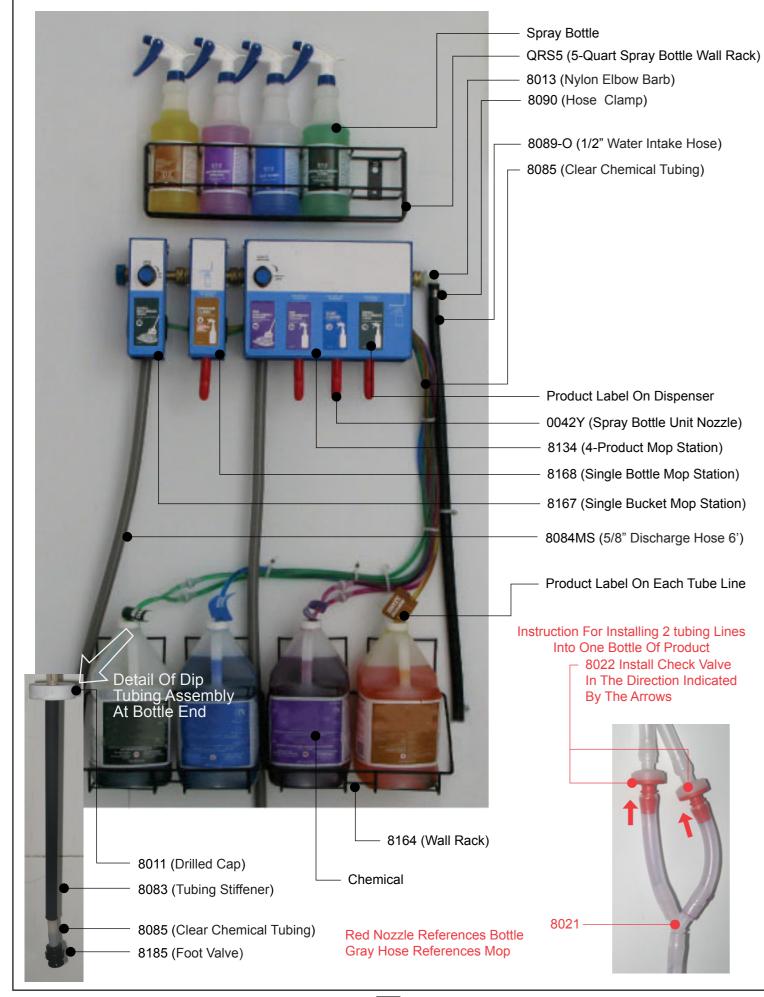

3

Metering Tip Selection:

The final concentration of the dispensed solution is related to both the size of the metering tip opening and the viscosity of the liquid being siphoned. For water-thin products, the chart below can be used as a guideline. If product is noticeably thicker than water, actual dilution achieved can only be ascertained by measurement. Because dilution can vary with water temperature and pressure.

unning) tle SI .5 4 6 8
SI .5 4 6 8
.5 4 6 8
4 6 8
6 8
8
-
-
2
4
5
7.5
9
.5
4
:9
3
9
7
3
'8
03
33
80
75
50

